


FIRE LANE DESIGN GUIDELINES

Minimum fire lane width 24'. Minimum vertical clearance 14'.

Emergency vehicle turn-arounds if required must have a minimum diameter of 100'.


Fire Lanes must extend to within 150' of all portions of the exterior walls of the first story.

Fire Lane striping to be continuous red 6" base with 4" white lettering "**FIRE LANE NO PARKING**"
 Fire Lane striping/lettering to be placed on flat surface of roadway and on vertical surface of curb where curbs are present.

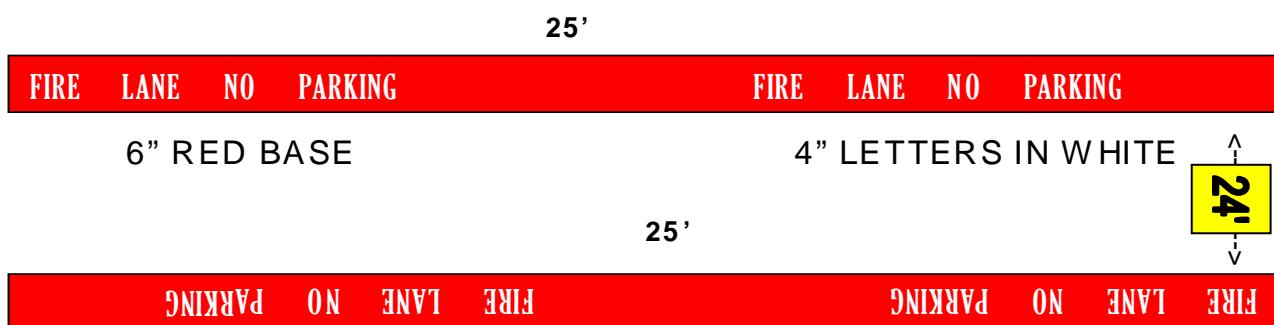

FIRE LANE DESIGN

W	R	W _R
20'	30'	30' min
25'	20'	30' min
30'	10'	30' min

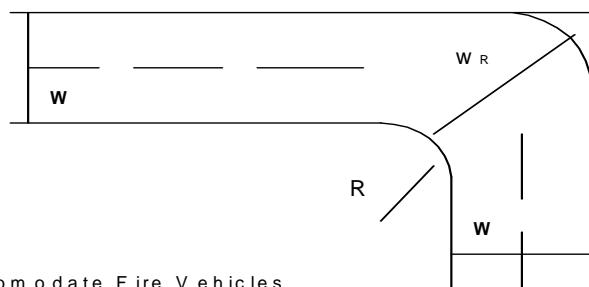

W = Width (Feet) of Fire Lane
 R = Radius Necessary to Accommodate Fire Vehicles
 W_R = Turning Radius Pavement Width